

PROFILE

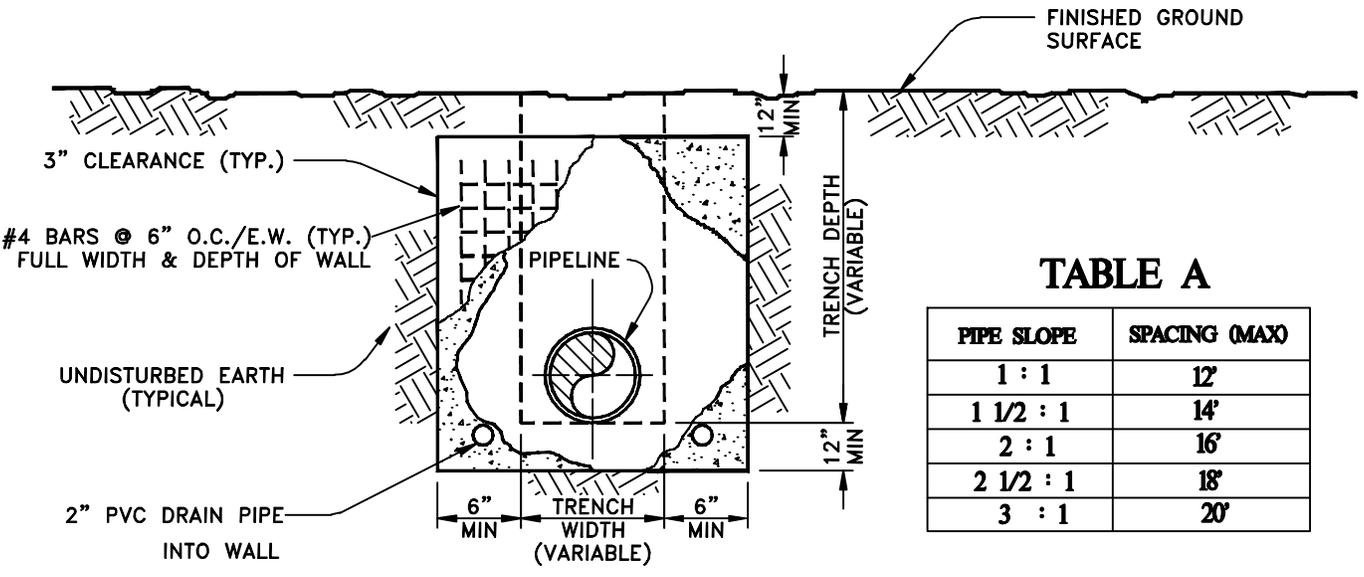


TABLE A

PIPE SLOPE	SPACING (MAX)
1 : 1	12'
1 1/2 : 1	14'
2 : 1	16'
2 1/2 : 1	18'
3 : 1	20'

NOTE:

1. WALLS TO BE INSTALLED WHERE DIRECTED ON THE PLANS OR BY THE CITY.
2. WALLS NOT TO BE PLACED WITHIN 3 FEET OF ANY PIPE JOINT.

AUGUST 2005

CITY OF CHIND HILLS		Approved by:
Revised: / /	by:	
Revised: / /	by:	
Revised: / /	by:	CITY ENGINEER

**PIPE ANCHOR WALLS
SLOPE PROTECTION**

W-22