


LIST OF MATERIAL

ITEM	DESCRIPTION	ROMAC	FORD	JONES	MUELLER	REMARKS
1	DOUBLE STRAP SERVICE SADDLE	202B OR 202BS	202-B962-1P7	J-969-D	BR-25	W/IP (AWWA) THREAD
2	BALL CORPORATION STOP, 2"	---	FB-1100-7Q	J-1935-SG	B-25028	IP THREAD
3	BALL ANGLE METER STOP, 2"	---	FA-A43-777W	J-1963-WSG	B-24276	
4	90° ELL, CxC	---	---	---	---	NIBCO
5	METER BOX	---	---	---	---	SEE PART III SEC. 2-9
5a	POLYMER CONC. COVER & LID	---	---	---	---	SEE PART III SEC. 2-9
6	2" COPPER TUBE, TYPE K,	---	---	---	---	20' LENGTHS
7	1/2" CRUSHED ROCK, 4" BASE	---	---	---	---	
8	BALL VALVE	---	---	---	---	
9	WATER METER (PROVIDED BY CITY)					

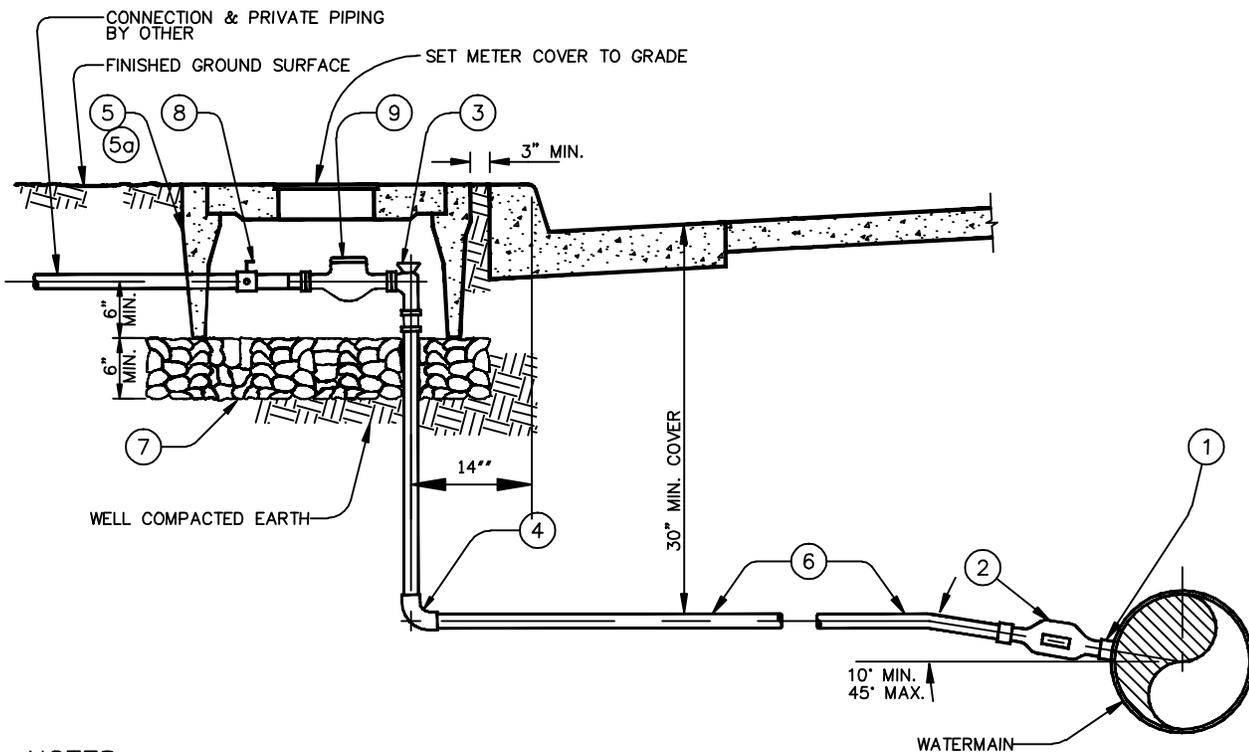

NOTES:

1. INSTALL BALL CORPORATION STOP WITH KEY TO SIDE.
2. SERVICE SADDLE AND BALL CORPORATION STOP SHALL BE IP (AWWA) THREAD.
3. TAPS SHALL BE MADE AT LEAST 24" FROM ANY OTHER TAP OR COUPLING.
4. STANDARD 2" SERVICE IS USED FOR 1-1/2" METER AND 2" METER.
5. CHIP 3" "W" IN CURB FACE ON METER SIDE TO IDENTIFY CORP STOP LOCATION.
6. USE 95/5 (TIN-ANTIMONY) OR SILVER SOLDER
7. IN AREAS WITHOUT CURB OR WITH ROLLED CURB USE TRAFFIC LOAD RATING COVER.
8. STAINLESS STEEL STRAP SADDLE SHALL BE USED ON PVC PIPE.

AUGUST 2005

CITY OF CHIND HILLS		Approved by: CITY ENGINEER	1-1/2" AND 2" WATER SERVICE INSTALLATION	W-11
Revised: / / by:				
Revised: / / by:				