


NOTE: SEE PAGE 2 OF 2 FOR GENERAL NOTES

PLAN VIEW

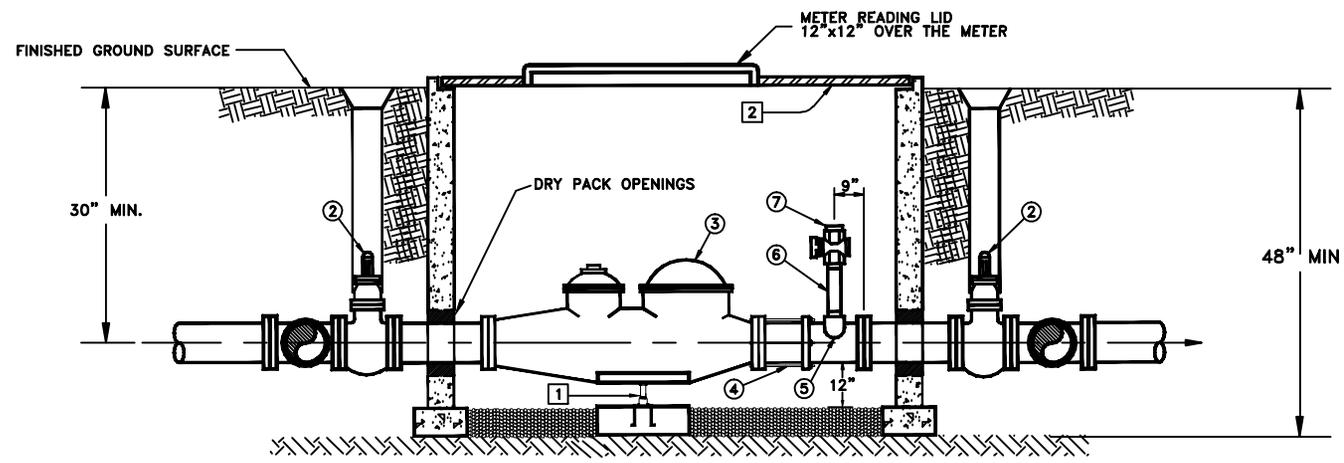

SECTION A-A

AUGUST 2005

CITY OF CHIND HILLS	
Revised: / /	by:
Revised: / /	by:
Revised: / /	by:
Approved by:	
CITY ENGINEER	

**3" THROUGH 6" COMPOUND
METER ASSEMBLY**

W-13

ITEM	QTY	LIST OF MATERIALS
①	2	A.S.A. #150 FLANGE.
②	3	RESILENT SEAT GATE VALVE PER SPECIFICATIONS PART 3, SECTION 2-04.02
③	1	METER FURNISHED BY CITY.
④	1	STEEL FLANGED COUPLING ADAPTER, ROCKWELL #913 OR APPROVED EQUAL.
⑤	1	2" STD. STEEL HALF COUPLING WELDED TO PIPE.
⑥	1	2"Ø X 6" LONG STD. WT. GALV. PIPE THREADED BOTH ENDS.
⑦	1	2"Ø CURB STOP INSIDE I.P.T. X INSIDE I.P.T. JONES MODEL J-200 OR APPROVED EQUAL.

- ①—METER SHALL HAVE APPROVED PIPE SUPPORT, PER W-18.
- ②—ADJUST VAULT AND COVER TO MEET CURB GRADE. VAULT COVER MUST BE ALUMINUM WITH SPRING ACTION HINGES AND A 12"X12" READING LID OVER THE METER.
- ③—GALVANIZED LADDER PER ALHAMBRA FOUNDRY LADDER A-3400 OR APPROVED EQUAL.
- ④—PRECAST METER VAULT PER QUIKSET #300 OR APPROVED EQUAL.

AUGUST 2005

CITY OF CHIND HILLS			Approved by:	3" THROUGH 6" COMPOUND METER ASSEMBLY	W-13
Revised: / /	by:	CITY ENGINEER			
Revised: / /	by:				
Revised: / /	by:				
					2 OF 2