


## LIST OF MATERIAL

ITEM	DESCRIPTION	FORD	JONES	MUELLER	REMARKS
1	DOUBLE STRAP SERVICE SADDLE	202B	J-969 D	BR2B SERIES	IP (AWWA) THREAD
2	BALL CORPORATION STOP, 1"	FB-600	J-1935SG	B-25028	AWWA IP THREAD
3	BALL ANGLE METER STOP, 1"	BA23-444W	J-1963WSG	B-24258	
4	BALL CUSTOMER VALVE	—	J-1908	—	
5	METER BOX	—	—	—	SEE PART 3 SEC. 2-9
5a	POLYMER CONC. COVER & LID	—	—	—	SEE PART 3 SEC. 2-9
6	1/2" CRUSHED ROCK, 4" BASE	—	—	—	
7	1" COPPER TUBE, TYPE K	—	—	—	NO SPLICES ALLOWED
8	WATER METER (PROVIDED BY CITY)				

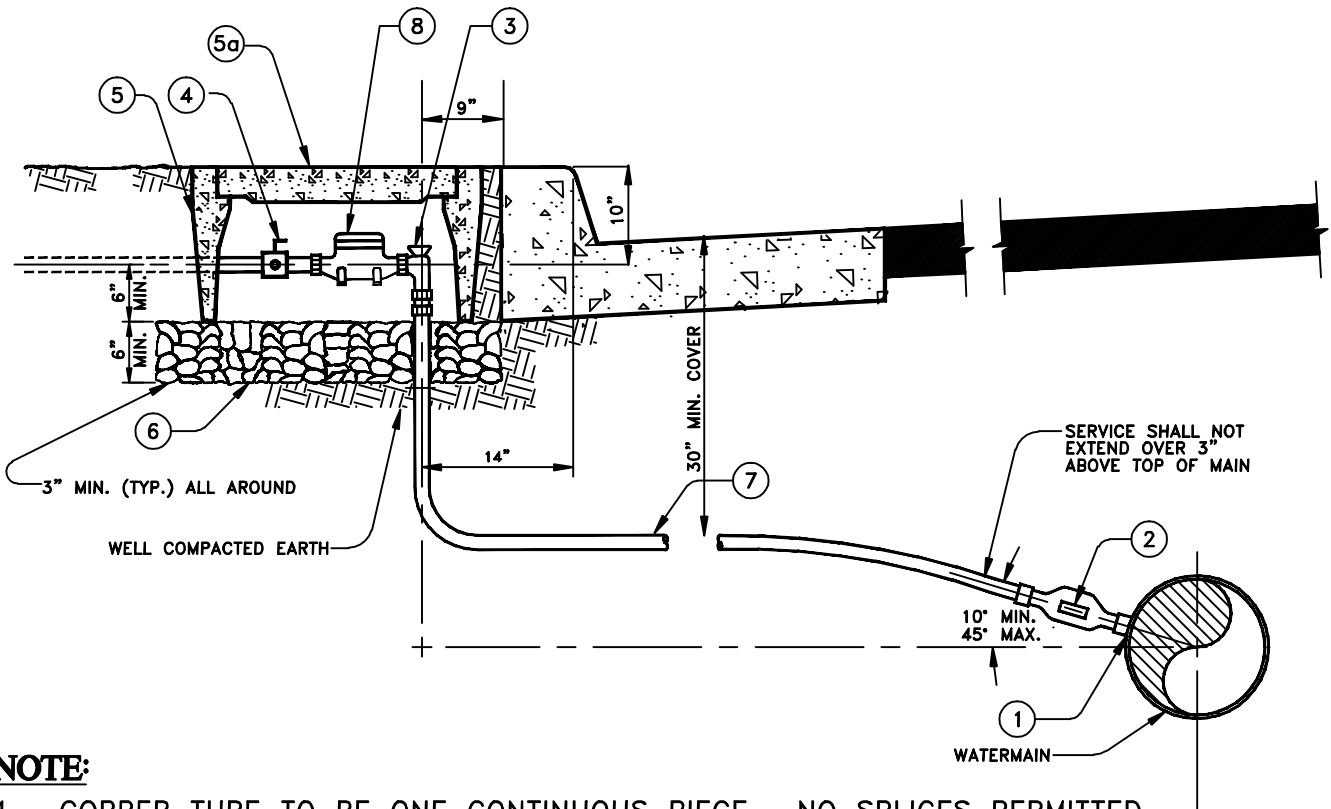

**NOTE:**

1. COPPER TUBE TO BE ONE CONTINUOUS PIECE. NO SPLICES PERMITTED.
2. SERVICE SADDLE AND BALL CORPORATION STOP SHALL BE IP (AWWA) THREAD.
3. INSTALL CORPORATION STOP WITH KEY ON SIDE.
4. TAPS SHALL BE MADE AT LEAST 24" FROM ANY OTHER TAP OR COUPLING.
5. STANDARD 1" WATER SERVICE SHALL BE USED FOR METERS UP TO 1 INCH.
6. CHIP 3" "W" IN CURB FACE ON METER SIDE TO IDENTIFY CORP STOP LOCATION.
7. IN AREAS WITHOUT CURB OR WITH ROLLED CURB USE TRAFFIC LOAD RATING COVER.
8. STAINLESS STEEL STRAP SADDLE SHALL BE USED ON PVC PIPE.

AUGUST 2005

CITY OF CHIND HILLS		<b>1" WATER SERVICE INSTALLATION</b>	<b>W-10</b>	
Revised: / /	by:			Approved by:
Revised: / /	by:			
Revised: / /	by:			