


LIST OF MATERIAL

ITEM	DESCRIPTION
①	RPP BACKFLOW PREVENTION DEVICE, CLA-VAL.CO MODEL RP-2 OR APPROVED EQUAL
②	WYE STRAINER, BRONZE
③	BRASS UNION
④	RISER AND NIPPLES – BRASS OR COPPER
⑤	90° ELBOW – BRASS OR COPPER

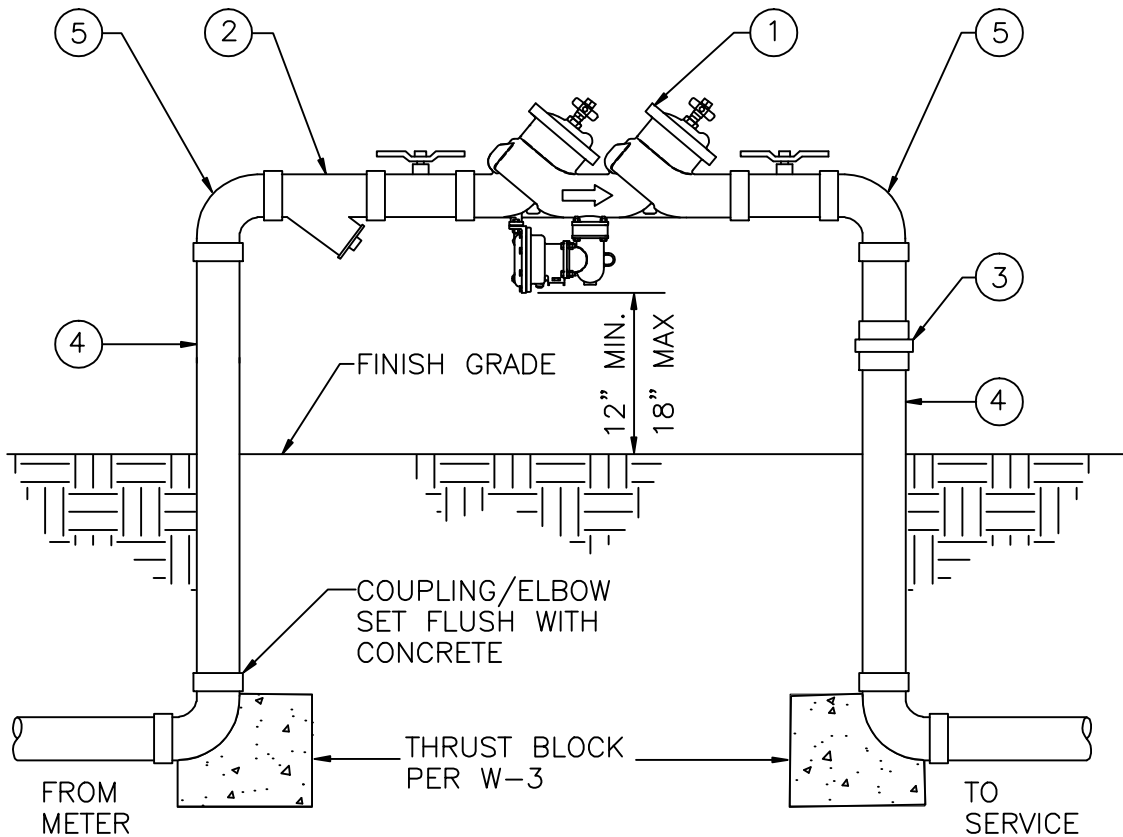

NOTES:

1. LOCATION AND INSTALLATION SHALL BE PER PLAN AS SUBMITTED TO AND APPROVED BY THE CITY ENGINEER.
2. NO CONNECTIONS TO BE MADE BETWEEN METER AND BACKFLOW PREVENTER.

AUGUST 2005

CITY OF CHIND HILLS		<p>Approved by:</p> <p>1" THROUGH 2" BACKFLOW PREVENTION DEVICE</p> <p>W-16</p>
Revised: / /	by:	
Revised: / /	by:	
Revised: / /	by:	CITY ENGINEER